



CITY OF BISHOP

377 West Line Street - Bishop, California 93514
Post Office Box 1236 - Bishop, California 93515
760-873-8458 publicworks@ca-bishop.us
www.ca-bishop.us/CityofBishopPublicWorks.html

Addendum 1


16 March 2011

North Second Street Water Improvements Project

This addendum makes the following changes to the 28 February 2011 Bidding Information and Contract Documents for this project:

1. Replace Standard Detail W-1 with the attached detail.
2. Add the attached Standard Detail W-4.

David Grah
Director of Public Works

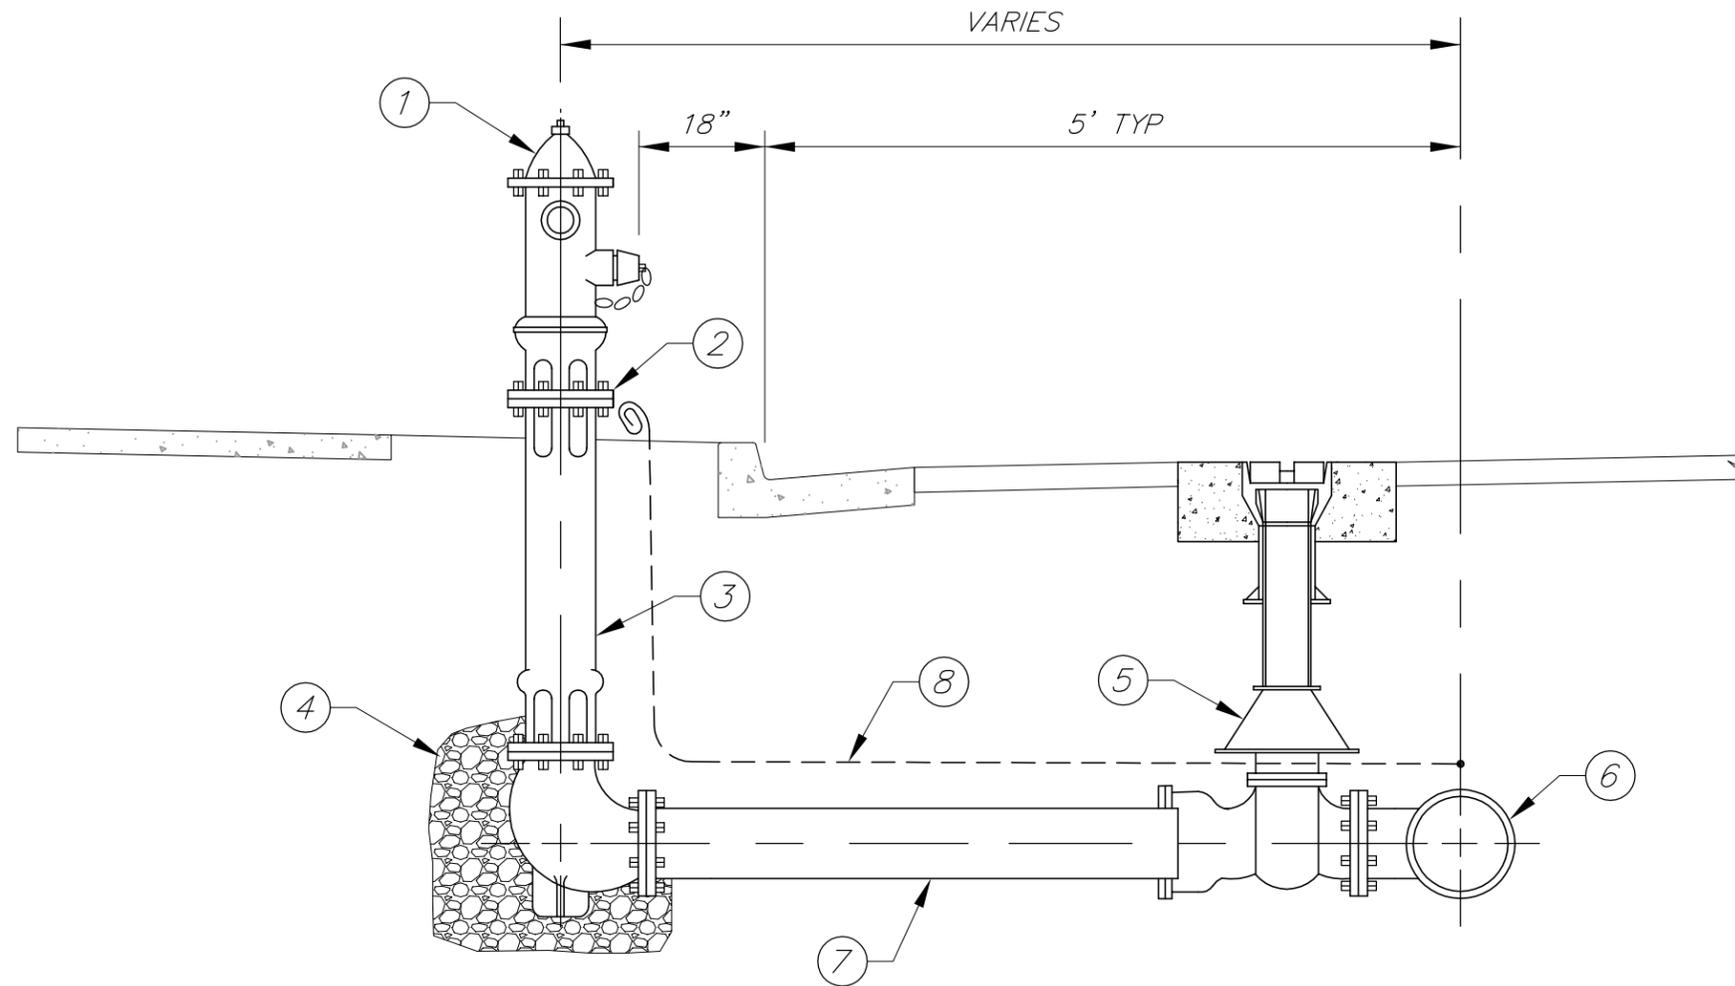


NOTES:

1. FIRE HYDRANT TO CONFORM WITH AWWA SPECIFICATION C-502, MUELLER, CENTURION, MJ, 5 1/4" MAIN VALVE OPENING, A-423 (DRY BARREL) WITH TWO 2 1/2" AND ONE 4" NS THREADED NOZZLES. ABOVE GROUND PORTION TO BE PAINTED SAFETY YELLOW.
2. SAFETY FLANGE, 3" TO 5" ABOVE SIDEWALK OR GROUND. PROVIDE BOLLARDS IN AREAS WITHOUT CURB.
3. BURIED PORTION OF HYDRANT TO BE COATED WITH COAL TAR ENAMEL OR COAL TAR EPOXY.
4. MINIMUM 7 CUBIC FEET OF CRUSHED ROCK AROUND DRAIN VALVES..
5. 6" FL x MJ GATE VALVE. SEE W-4 FOR VALVE BOX AND RISER.
6. WATER MAIN LINE.
7. 6" C900 WITH RESTRAINED JOINTS.
8. LOCATOR WIRE. CONNECT TO LOCATOR WIRE FOR WATER MAIN.

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION
FIRE HYDRANT ASSEMBLY

	APPROVED BY PUBLIC WORKS DIRECTOR		STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION		
	DATE		FIRE HYDRANT ASSEMBLY		
	DATE		REVISION	STANDARD DETAIL NO. W-1	
	DATE		SCALE: NOT TO SCALE		

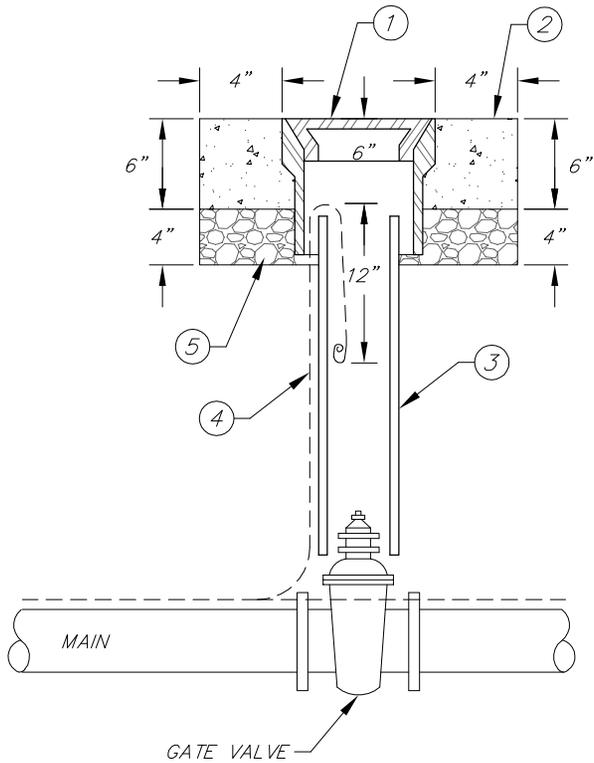

NOTES:

1. CHRISTY G-5 VALVE BOX.
2. CLASS 1 CONCRETE COLLAR.
3. 8" PVC SDR 35 RISER.
4. LOCATOR WIRE.
5. AGGREGATE BASE

STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION
VALVE BOX & RISER

	APPROVED BY PUBLIC WORKS DIRECTOR		STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION	
			VALVE BOX & RISER	
	DATE	REVISION	STANDARD DETAIL NO.	
			W-4	
	DATE		SCALE: NOT TO SCALE	